

FLUTED METAL DECK FILLED WITH CONCRETE

MIN #6 FRAMING SCREWS @ 24" O.C. MAX.

TYPICAL STEEL FASTENERS OR SCREW TO STRAP @ 12" O.C. MAX. REFERENCE FASTENER MFR ICC-ES REPORT FOR FASTENER CAPACITY OR PER E.O.R.

20 GA CEMCO FAS STRAP WITH INTUMESCENT


CEMCO FAS TRACK DL2

5/8" TYPE 'X' DRYWALL

TYP DRYWALL SCREW

STEEL STUD 0.018 MIL MIN. @ MAX. 24" O.C.

1" NOMINAL GAP
4 1/2" - 5 1/2"

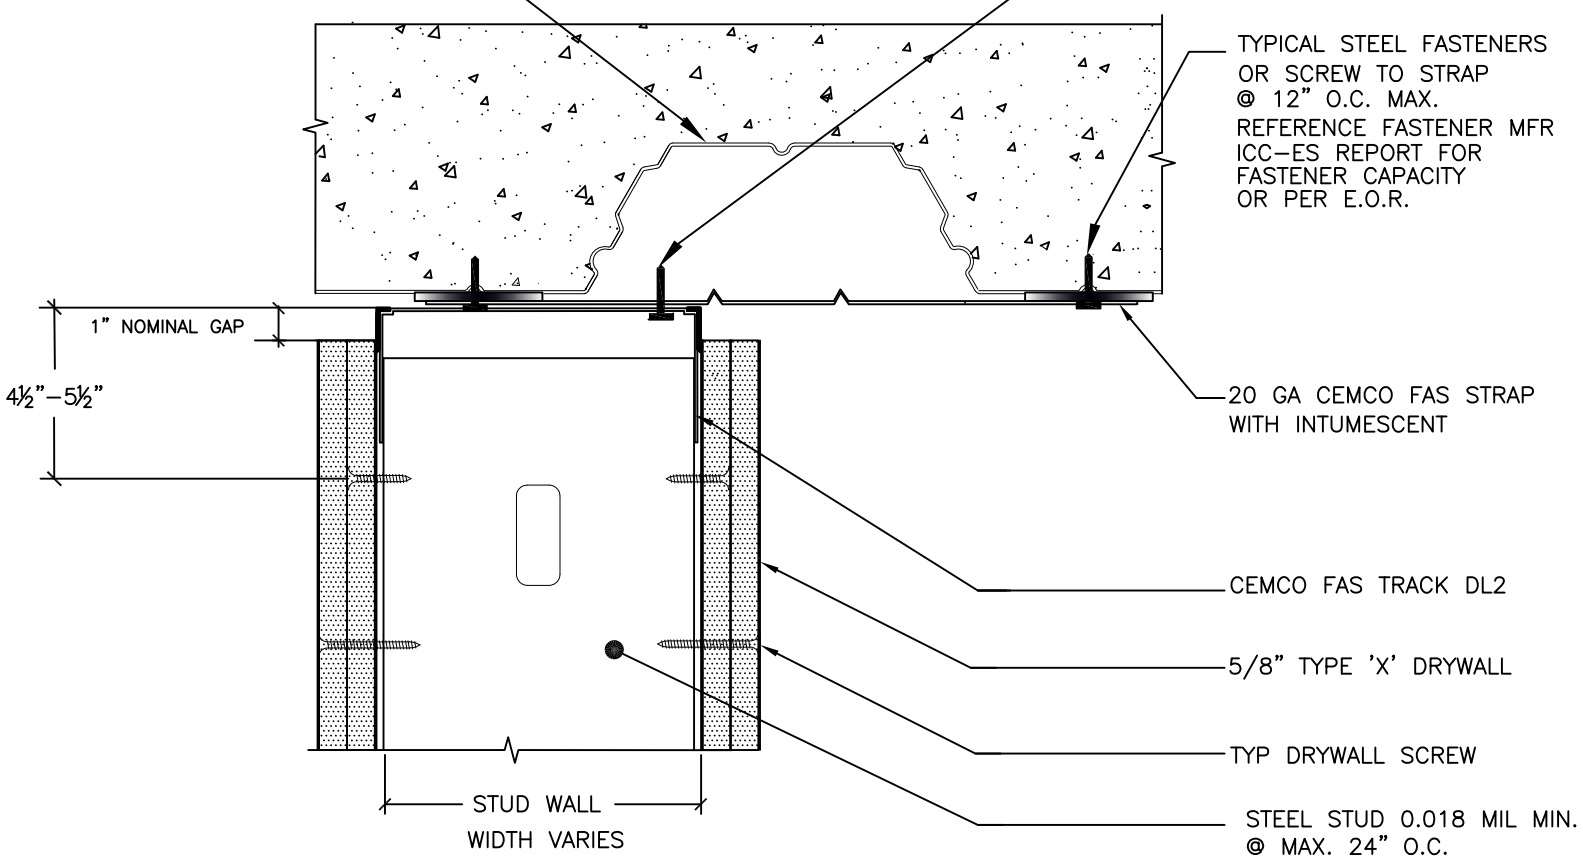

HW-D-0587 PARALLEL WITH FLUTED DECK.
 HEAD OF WALL SYSTEM 1, PARALLEL AND OFFSET UNDER
 FLUTED DECK. 1 AND 2 HOUR FIRE RESISTANT ASSEMBLY
 (SEE UL LISTING FOR WALL FIRE RATING). UL-2079 TEST STD.
 AVAILABLE IN 1 HOUR-SINGLE LAYER OF GYPSUM WALLBOARD

